

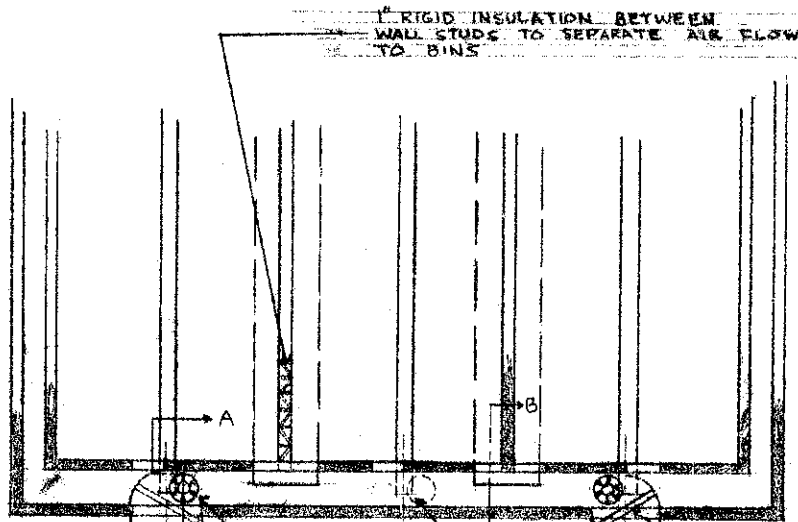



NOTE: INLET EXHAUST HOOD & DAMPER AS SHOWN IN FIGURE 7, EXTENSION CIRCULAR AE-90 "POTATO STORAGE VENTILATION"

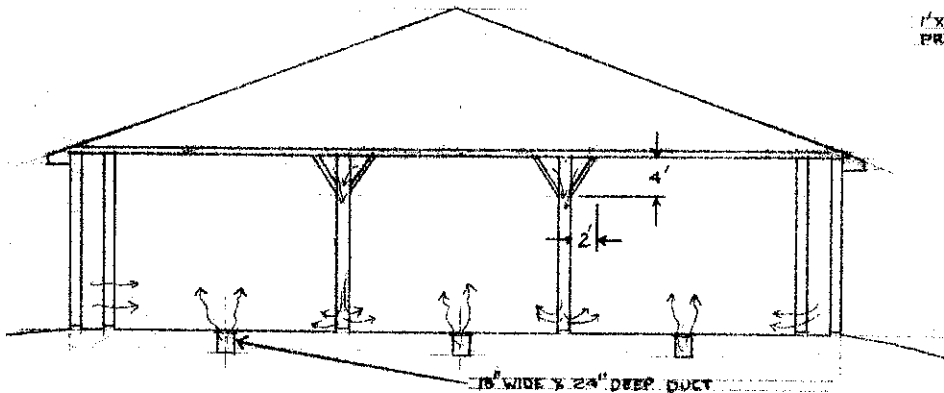

LOCATION FOR FUTURE FAN, IF USED FOR WARM STORAGE  
 9000 CFM FAN @ 1/2" STATIC PRESSURE  
 APPROX. 27" DIA. 2 N.P.

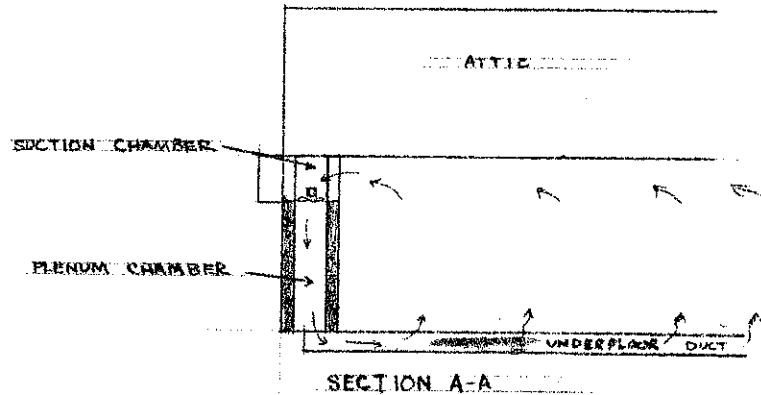

1/2 X 5" OPENING TO FEED PRESSURE AIR TO DUCTS

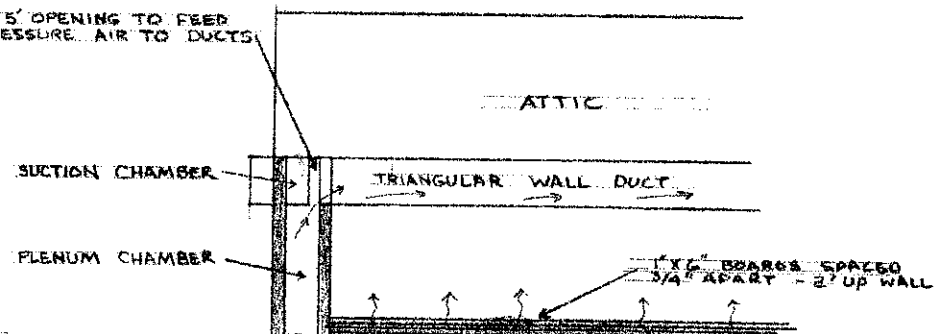

VENTILATION FOR 3-BIN 10000 CWT COLD POTATO STORAGE		
SCALE	1/2" = 1'	DESIGNER E. J. LUNDSTADT
EXTENSION: DR. ENGINEER NORTH CAROLINA STATE UNIVERSITY		
DATE 4-17-75	APPROVED BY N.D. 835-3-4	DRAWING NUMBER J SH.